


SL. NO: 01

REC  
CONSTRUCTION STANDARD  
K-1

(REVISED-1987)

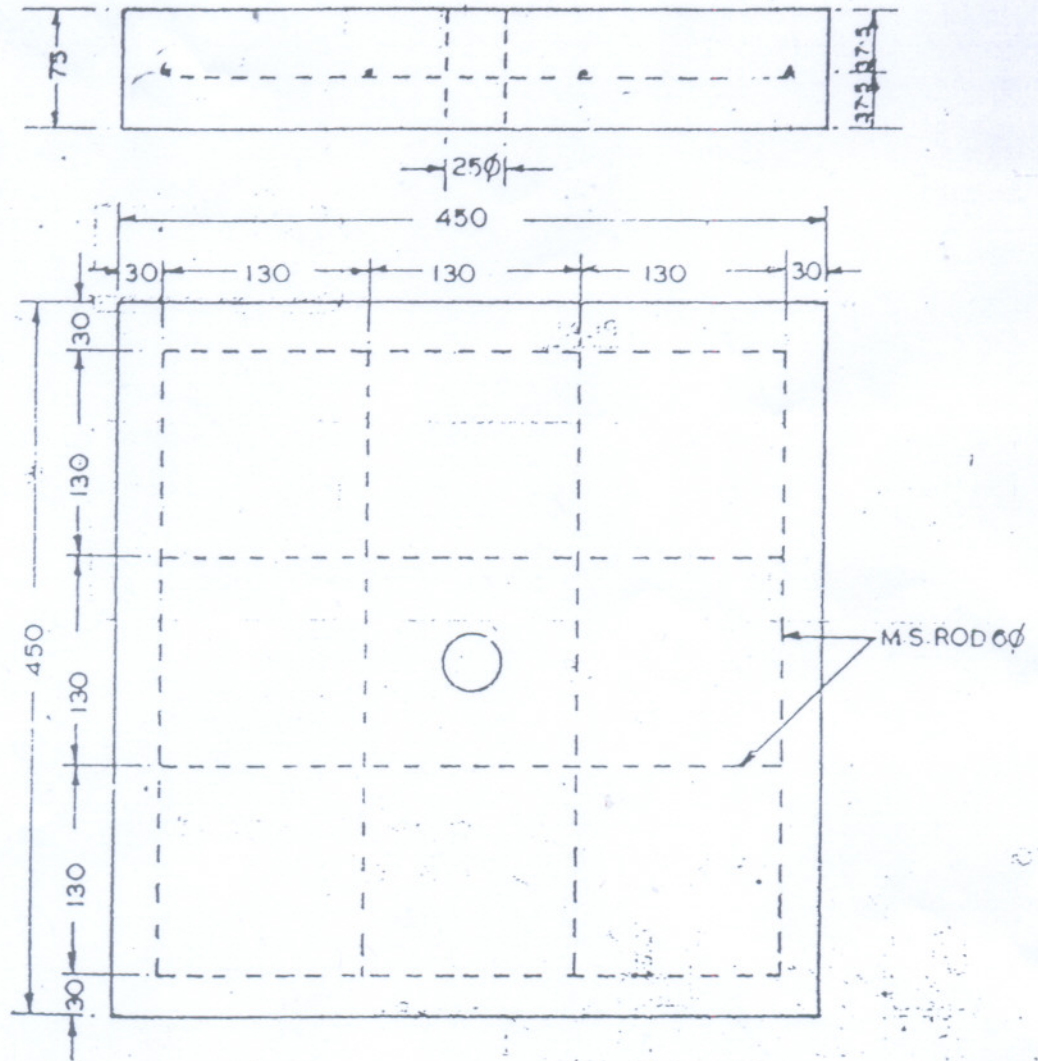

NOTES:-

1. THE CONCRETE MIX SHALL BE OF M-15 GRADE.
2. EQUIVALENT SIZE OF STONE PAD CAN BE USED AS 'BASE PLATE' WHEREVER AVAILABLE ECONOMICALLY.
3. BASE PLATE IS NOT NECESSARY FOR CONCRETED LOCATIONS.  
REF. ALTERNATIVE K-4 USING 4mm DIA H.T.S WIRES AS REINFORCEMENT.

ALL DIMENSIONS ARE IN mm.

आर.सौ.सी. आधार/एंकर प्लेट

R.C.C

BASE/ANCHOR PLATE

(USING M.S. ROD REINFORCEMENT)

SCALE: - N.T.S | SEPT. -1972/R-1987